


# Alarm RFID keypad toevoegen aan Fibaro Home Center

Het toevoegen van de keypad doe je door de Fibaro Smart Implant aan je Home Center toe te voegen en 1 instelling aan te passen.

Het gaat om het juist instellen van de Inputs. Dit doe je in de Advanced Settings van het main device.

## Home Center 2/Lite

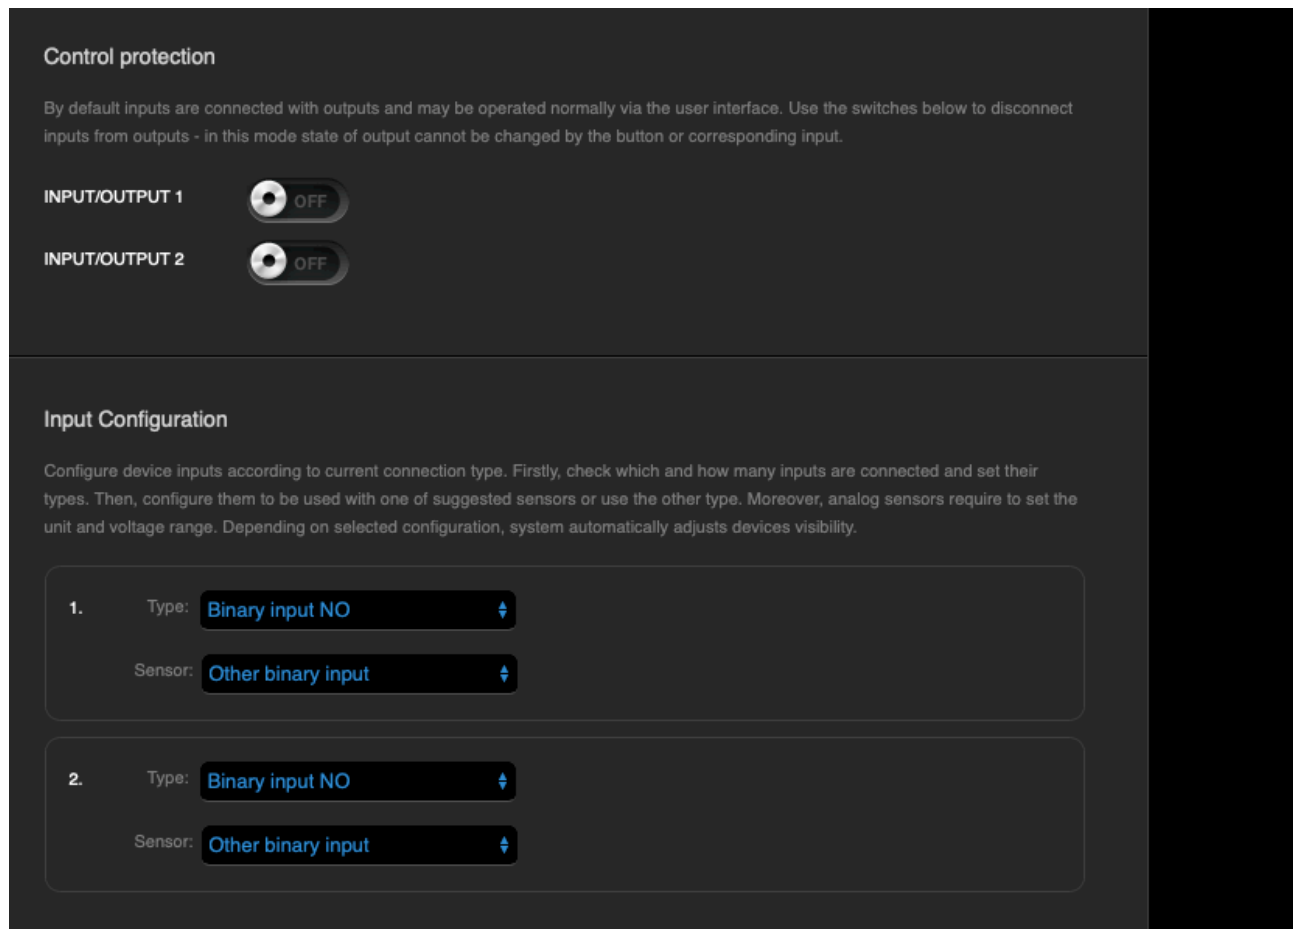

# Home Center 3 (lite)

Klik op het systeemwiel



ID: 958

957.0

## Access Protection

### Local protection

By default inputs are connected with outputs and may be operated normally via the user interface. Use the switches below to disconnect inputs from outputs - in this mode state of output cannot be changed by the button or corresponding input.

INPUT/OUTPUT 1

INPUT/OUTPUT 2

### Input Configuration

Configure device inputs according to current connection type. Firstly, check which and how many inputs are connected and set their types. Then, configure them to be used with one of suggested sensors or use the other type. Moreover, analog sensors require to set the unit and voltage range. Depending on selected configuration, system automatically adjusts devices visibility.

1. Binary input NO  >

2. Binary input NO  >